

# EHT 50, 100, 150, 200, 250, 300 INSTALLATION DRAWING



## NOTES:

- REFER TO INSTALLATION PROCEDURE AND INSTALLATION CHECKLIST.
- PROCEPTOR SEPARATORS MUST BE INSTALLED IN ACCORDANCE WITH ALL RELEVANT FEDERAL, PROVINCIAL/STATE, AND LOCAL CODES INCLUDING LOCAL PLUMBING CODE.
- US PATENT # 5,746,912; CDN PATENT # 2,195,822

### TABLE 2

TANK MODEL	INLET INVERT TO TANK BOTTOM (H*)	DRY WEIGHT OF TANK
EHT 50	12"	115 lbs
EHT 100	20"	130 lbs
EHT 150	28"	160 lbs
EHT 200	36"	185 lbs
EHT 300	52"	235 lbs

DOUBLE TANK WEIGHT FOR DOUBLE WALL TANKS

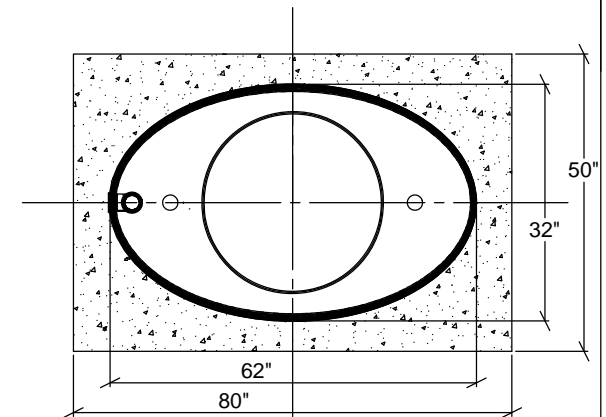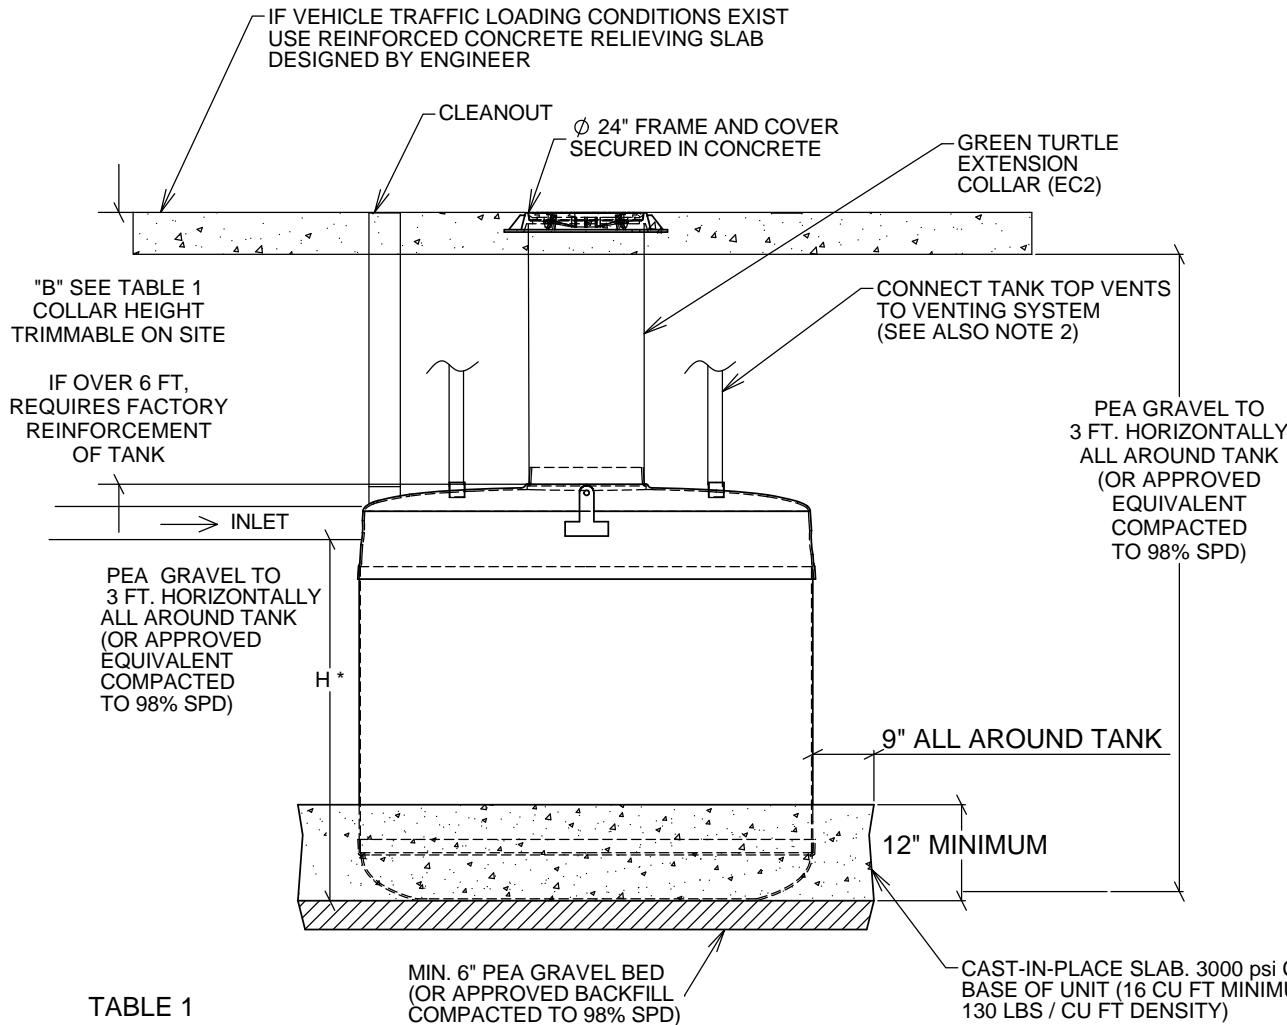

ANTI-BUOYANCY SLAB DIMENSIONS

### TABLE 1

BURIAL DEPTH	B
Max.	6 FT.
Min. with Traffic	18"
Min. no Traffic**	12"

\*\* ESTIMATED MINIMUM SPACE REQUIRED TO FIT VENT ELBOWS UNDER FLOOR

TITLE: PROCEPTOR HOLDING TANK  
INSTALLATION DRAWING  
FOR EHT MODELS 50-300

ALL DIMENSIONS IN INCHES

PROJECT: WO:

REV	DATE	DRAWN BY
1	NOV. 23, 2006	L. SIMKINS
2	JANUARY 17, 2008	L. SIMKINS
3	MAY 22, 2009	L. SIMKINS
4	JUNE 24, 2013	S. MANGAT
5	MAY 11, 2016	
6		
7		
8		
9		
10		

DRAWN BY: L. SIMKINS

DRAWN DATE: 6/29/6

**Proceptor**  
**ZURN**

SIZE	DWG. NO.	REV.
A	INSTALL EHT 50-300	6

SCALE: 1:35 DO NOT SCALE DRAWING SHEET 1 OF 1