

GMC 500-P, 750-P, 1000-P, 1300-P, 1500-P, 2000-P UPC FOR UPC/IAPMO INSTALLATION DRAWING

NOTES:

- REFER TO INSTALLATION PROCEDURE AND INSTALLATION CHECKLIST.
- PROCEPTOR SEPARATORS MUST BE INSTALLED IN ACCORDANCE WITH ALL RELEVANT FEDERAL, PROVINCIAL/STATE, AND LOCAL CODES INCLUDING LOCAL PLUMBING CODE.
- US PATENT # 5,746,912; CDN PATENT # 2,195,822

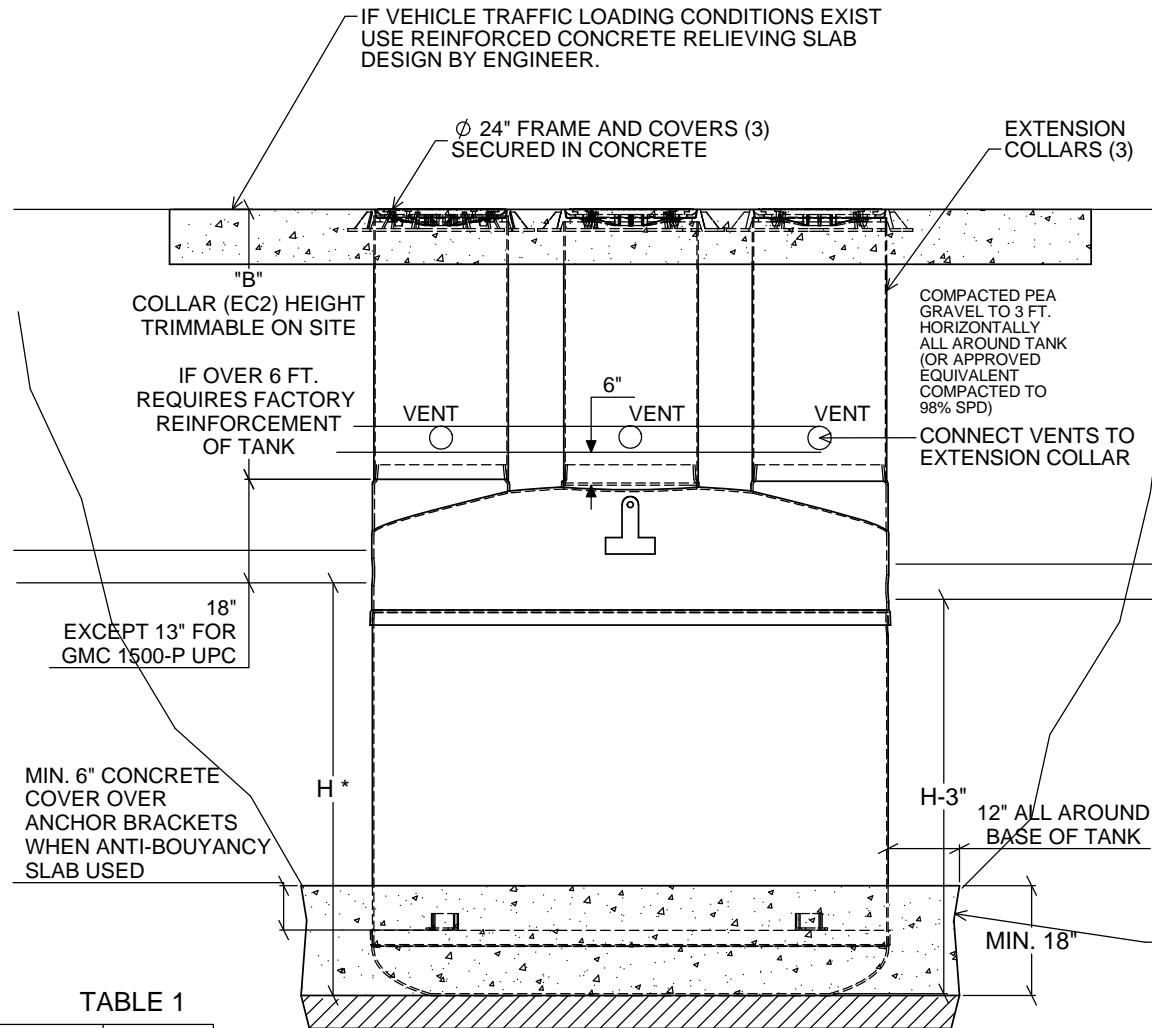


TABLE 2

PROCEPTOR SEPARATOR MODEL	INLET INVERT TO TANK BOTTOM (H*)	DRY WEIGHT OF TANK
GMC 500-P UPC	33"	650 lbs
GMC 750-P UPC	46"	733 lbs
GMC 1000-P UPC	60"	832 lbs
GMC 1300-P UPC	75"	951 lbs
GMC 1500-P UPC	83"	1000 lbs
GMC 2000-P UPC	110"	1500 lbs

TABLE 1

BURIAL DEPTH	B
Max.	6 ft.
Min. with Traffic	18"
Min. with Alarm	14"
Min. no Traffic	** 12"

** ESTIMATED SPACE REQUIRED TO FIT VENT ELBOWS UNDER FLOOR

CAST IN PLACE SLAB.
3000 psi CONCRETE READY MIX POUR 12 INCHES ALL AROUND BASE OF UNIT. 58 CU FT MINIMUM VOLUME OF CONCRETE POURED BASED ON CONCRETE DENSITY OF 130 LBS / CU FT.

TITLE: PROCEPTOR F.O.G. SEPARATOR
INSTALLATION FOR GMC 500-P, 750-P,
1000-P, 1300-P, 1500-P, 2000-P UPC

PROJECT: WO:

REV	DATE	DRAWN
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		

DRAWN BY: F CHANDLER

DRAWN DATE: 2018/08/08



SIZE	DWG. NO.	REV.
A	INSTALL GMC 500-P-2000-P UPC	0

SCALE:1:35 DO NOT SCALE DRAWING SHEET 1 OF 1