



SEE OWNER'S MANUAL FOR  
CALIBRATION PROCEDURE

ALARM IS SHOWN TO BE  
INSTALLED ON OUTLET SIDE OF  
TANK

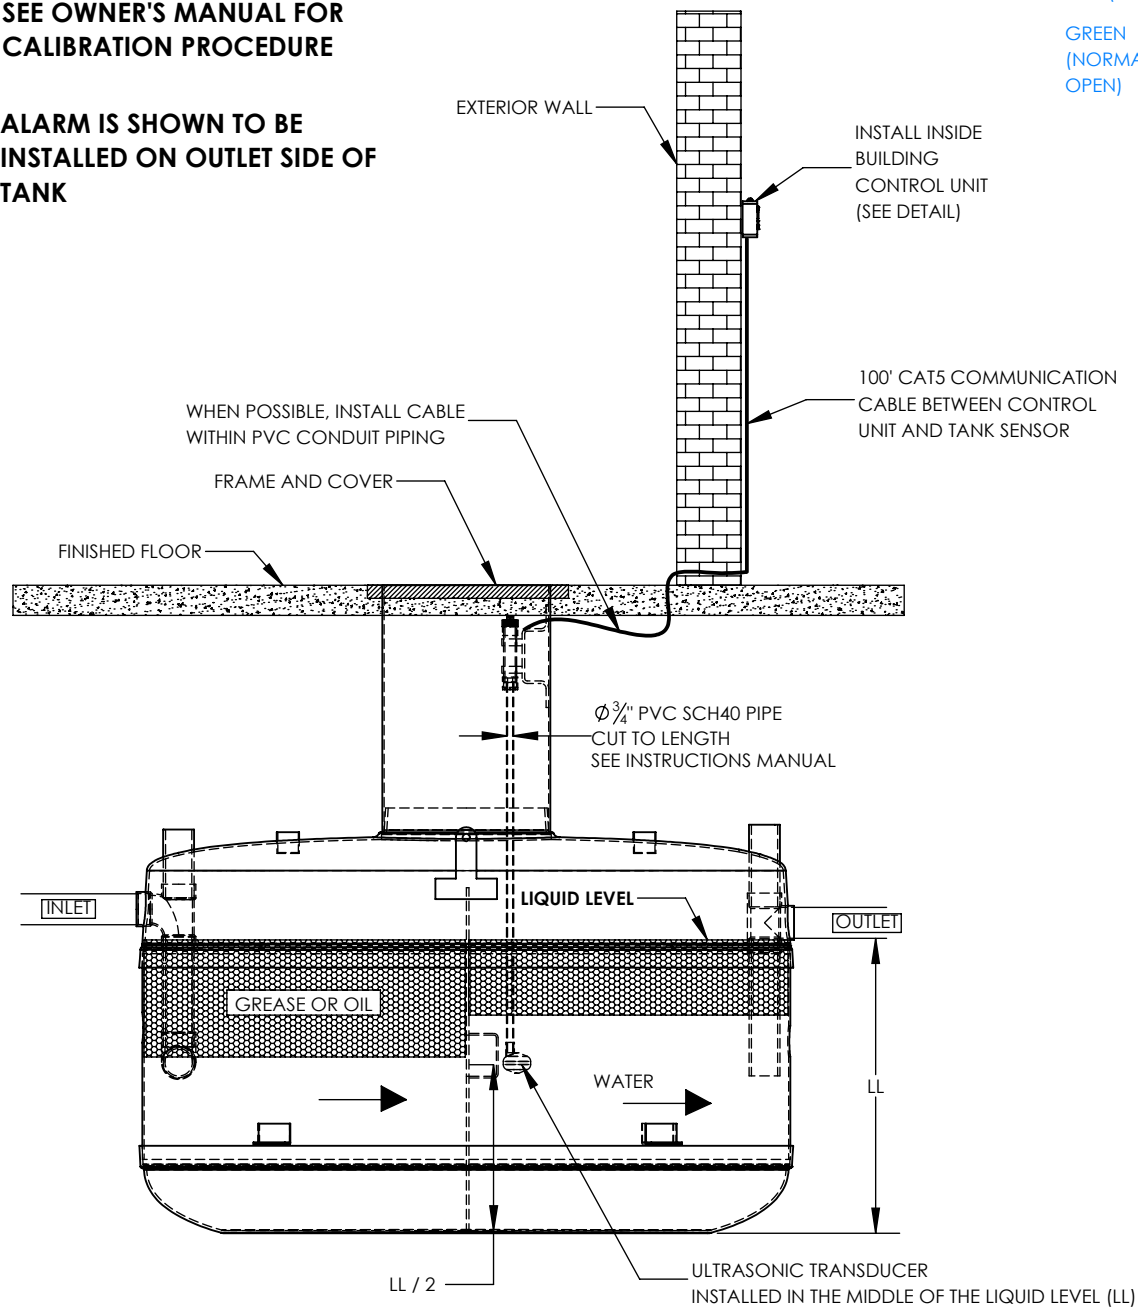

IN PROCEPTOR GMC OR OMC SEPARATOR MULTIPLE  
TANK SYSTEMS, THE ALARM IS USUALLY MOUNTED IN  
THE MANWAY OF THE LAST TANK IN SERIE


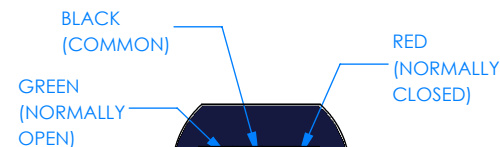


DETAIL A  
SCALE 1 : 2


BUILDING AUTOMATION  
ALARM OUTPUT

LCD DISPLAY OF  
TANK CONDITIONS

ALARM MONITOR  
INCLUDES AUDIBLE  
AND VISUAL ALARM



CONTROL UNIT

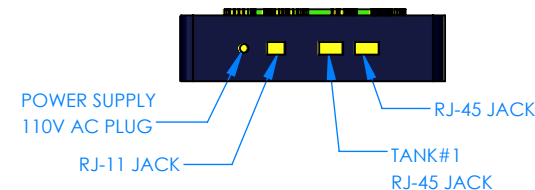

PLUG TRANSDUCER CABLE INTO TANK #1 RJ-45 JACK

DWG. TITLE:  
SMARTPRO WIRED  
ALARM G2  
INSTALLATION

PROJECT:

SIZE  
A

DRAWING NOT TO SCALE

**Proceptor®**  
**ZURN®**

DWG #: 21-5484-S

REV. 0