
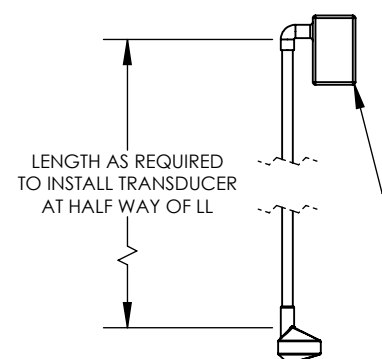


SEE OWNER'S MANUAL FOR CALIBRATION PROCEDURE

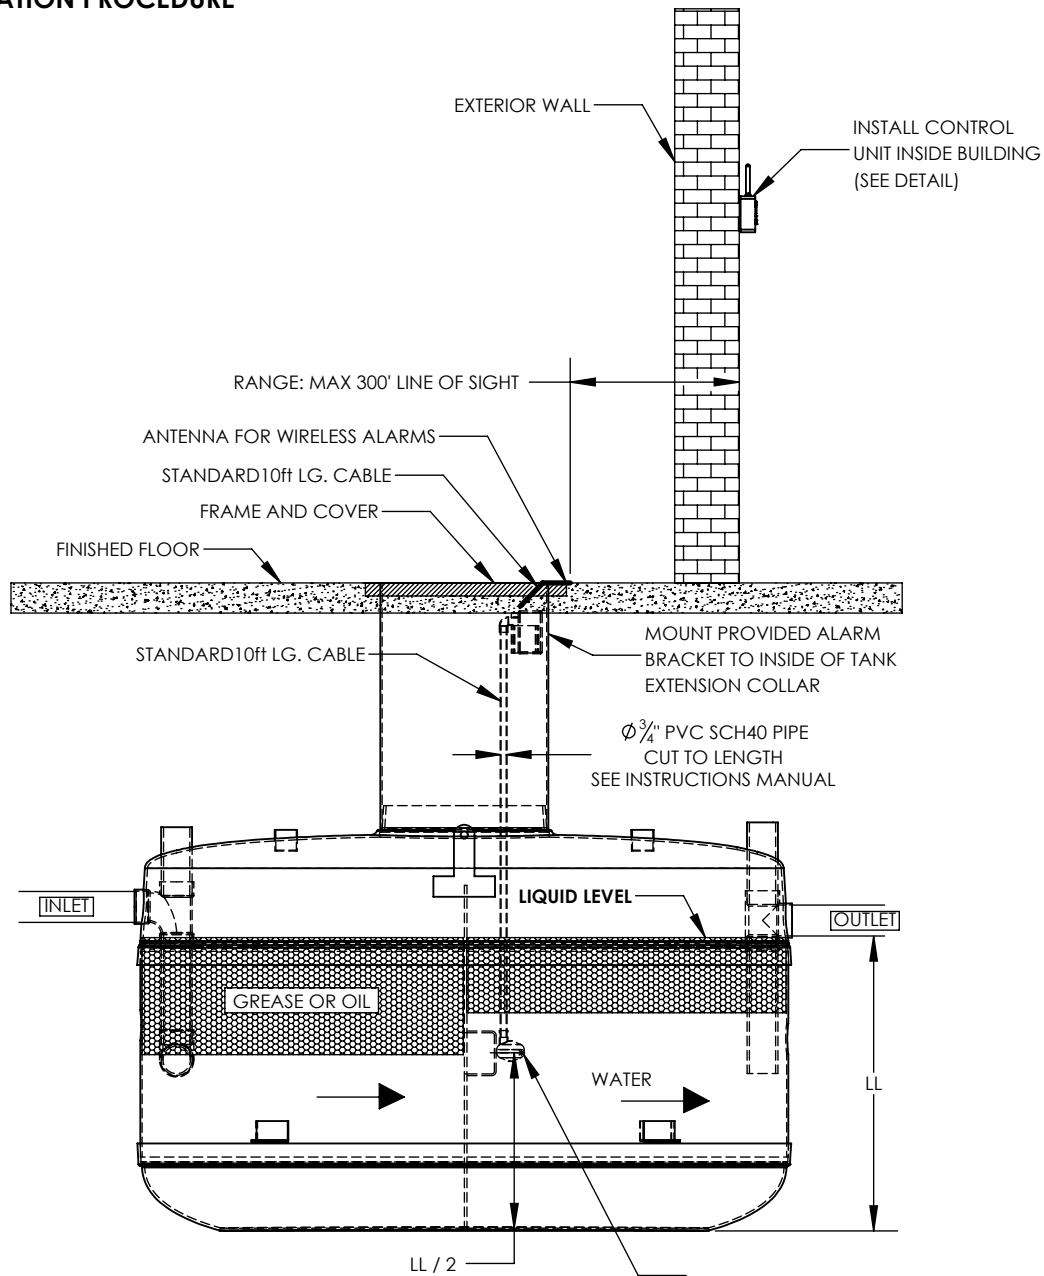

G3 IMD TANK UNIT
 G3 GREASEwatch® TANK UNIT INTERCEPTOR MONITORING EQUIPMENT. EACH G3 TANK UNIT TO BE INSTALLED INSIDE OF THE GREASE INTERCEPTOR TO MEASURE THE THICKNESS OF THE TOP GREASE LAYER, BOTTOM SLUDGE LAYER, CHANGE IN LIQUID LEVEL AND WASTEWATER TEMPERATURE INSIDE OF A GREASE INTERCEPTOR. G3 TANK UNIT IS POWERED BY A 3.9v LITHIUM BATTERY AND TRANSMITS DATA TO G3 WALL UNIT VIA CELL FREQUENCY.

TANK UNIT DETAILS

SKU:431

IN PROCEPTOR GMC OR OMC SEPARATOR MULTIPLE TANK SYSTEMS, THE ALARM IS USUALLY MOUNTED IN THE MANWAY OF THE LAST TANK IN SERIES

ALARM IS SHOWN TO BE INSTALLED ON OUTLET SIDE OF TANK

ALARM USES CELLULAR FREQUENCY

ULTRASONIC TRANSDUCER INSTALLED IN THE MIDDLE OF THE LIQUID LEVEL

DWG. TITLE: SMARTPRO WIRELESS ALARM G3 INSTALLATION
PROJECT:
SIZE (LA) DRAWING NOT TO SCALE



DWG #: 21-5485-S REV. 0