



G5 IMD TANK UNIT

G5 GREASEwatch® TANK UNIT INTERCEPTOR MONITORING EQUIPMENT. EACH G5 TANK UNIT TO BE INSTALLED INSIDE OF THE GREASE INTERCEPTOR TO MEASURE THE THICKNESS OF THE TOP GREASE LAYER, BOTTOM SLUDGE LAYER, CHANGE IN LIQUID LEVEL AND WASTEWATER TEMPERATURE INSIDE OF A GREASE INTERCEPTOR. G5 TANK UNIT IS POWERED BY A 3.9v LITHIUM BATTERY AND TRANSMITS DATA TO G5 GATEWAY VIA RADIO FREQUENCY.

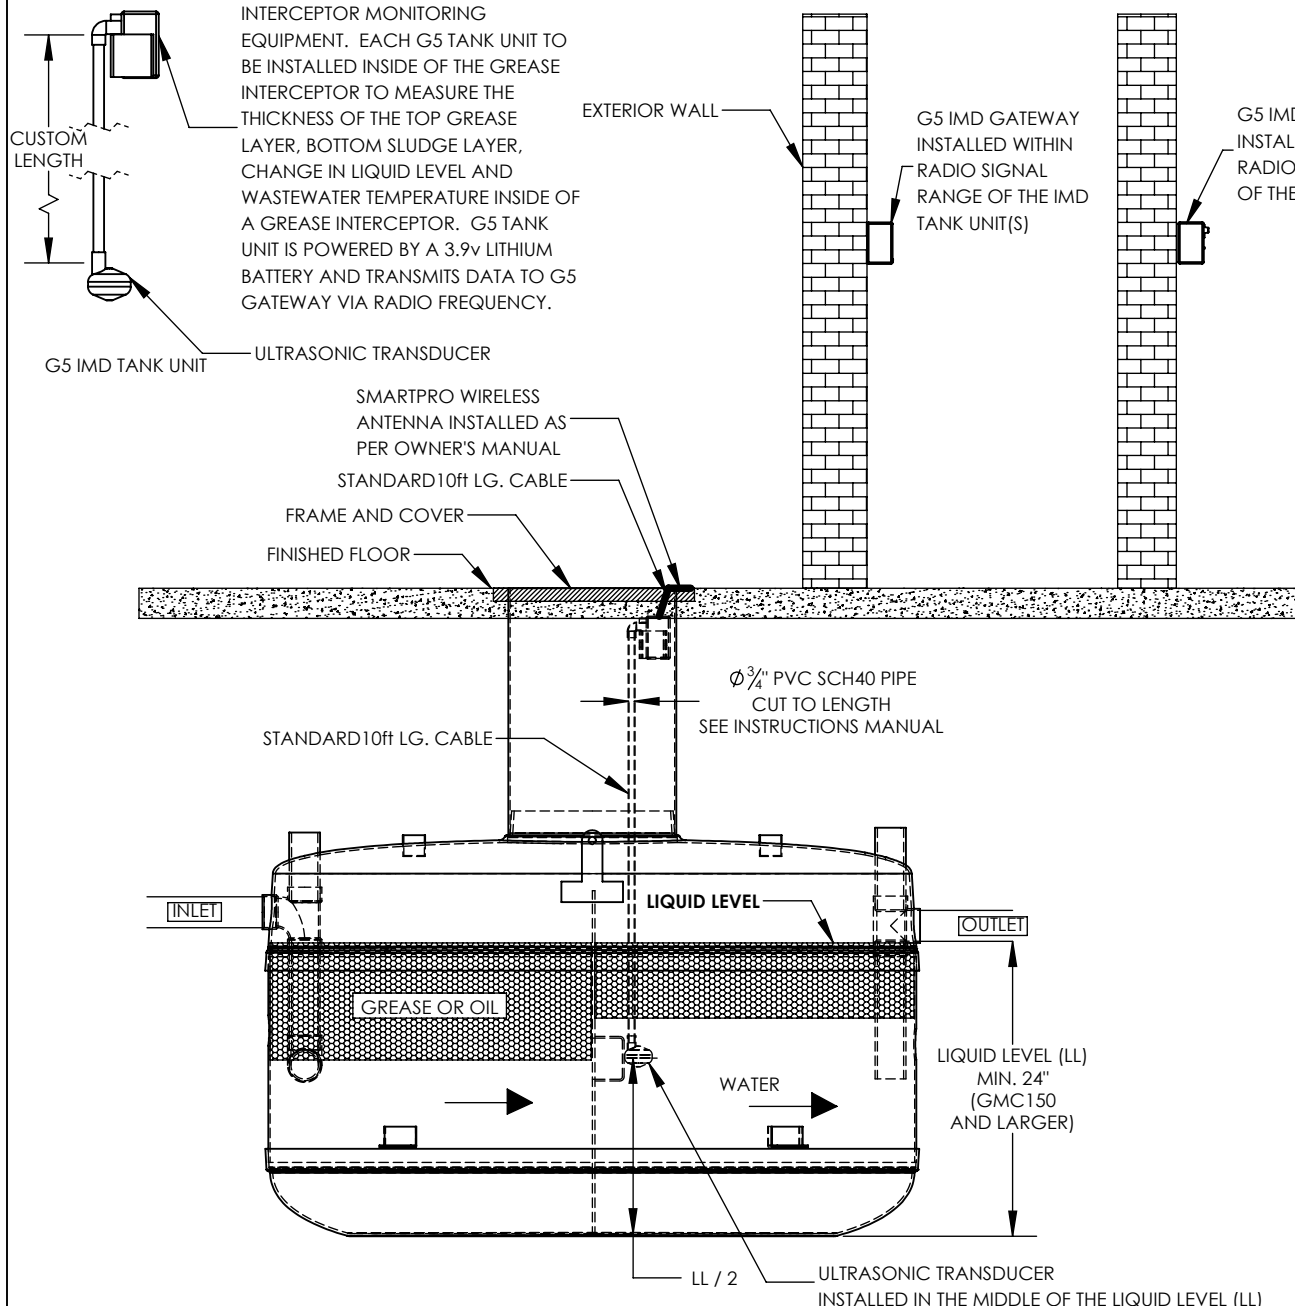


IN PROCEPTOR GMC OR OMC SEPARATOR MULTI TANK SYSTEMS, THE ALARM IS USUALLY MOUNTED IN THE MANWAY OF THE LAST TANK IN SERIES

**ALARM IS SHOWN TO BE INSTALLED
ON OUTLET SIDE OF TANK**

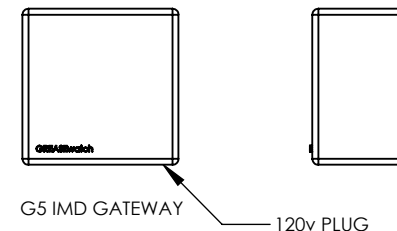

G5 IMD GATEWAY

THE G5 GREASEwatch® IMD GATEWAY IS TO BE INSTALLED INSIDE OR OUTSIDE OF BUILDING WITHIN RADIO SIGNAL RANGE (APPROX. 300ft LINE OF SIGHT) OF THE GREASEwatch IMD TANK UNIT(S) WHEN NEEDED. THE G5 GATEWAY RECEIVES DATA FROM THE G5 TANK UNIT(S) VIA RADIO FREQUENCY AND THEN FORWARDS DATA TO ATS WEBSITE FOR SIGNAL AND ALARM PROCESSING FOR A YEARLY FEE. G5 GATEWAY RECEIVER IS POWERED BY 120v POWER SUPPLY (PLUG) AND TRANSMITS DATA TO WEBSITE VIA CELLULAR TELEMETRY. THIS AVOIDS NUISANCE CALLS AND IS A NATURAL THEFT DETERRANT.

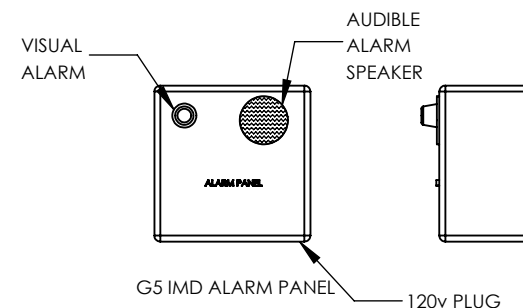

G5 IMD ALARM PANEL

G5 IMD AUDIBLE & VISUAL ALARM PANEL IS TO BE INSTALLED WITHIN RADIO SIGNAL RANGE (APPROX. 300ft LINE OF SIGHT) OF G5 IMD GATEWAY. G5 ALARM PANEL IS POWERED BY 120v POWER SUPPLY (PLUG). WHEN TANK UNITS ARE CLOSE TO ALARM PANEL, A COMBINATION GATEWAY AND ALARM PANEL BOX WILL BE USED.

SKU:4652 & G5R-ALARM

DWG. TITLE:
SMARTPRO G5 GATEWAY
WITH SEPARATE MONITOR
AND SEPARATE ALARM

PROJECT:

SIZE
A

DRAWING NOT TO SCALE

Proceptor®
ZURN®

DWG #: **21-5488-S**

REV. 0