




Z1970-K

9 [229] DIAMETER SHALLOW A.R.E. SANI-FLOR
RECEPTOR 3 [76] SUMP DEPTH W/ ANCHOR
FLANGE WITH SEEPAGE HOLES

SPECIFICATION SHEET

TAG _____

Dimensional Data (inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

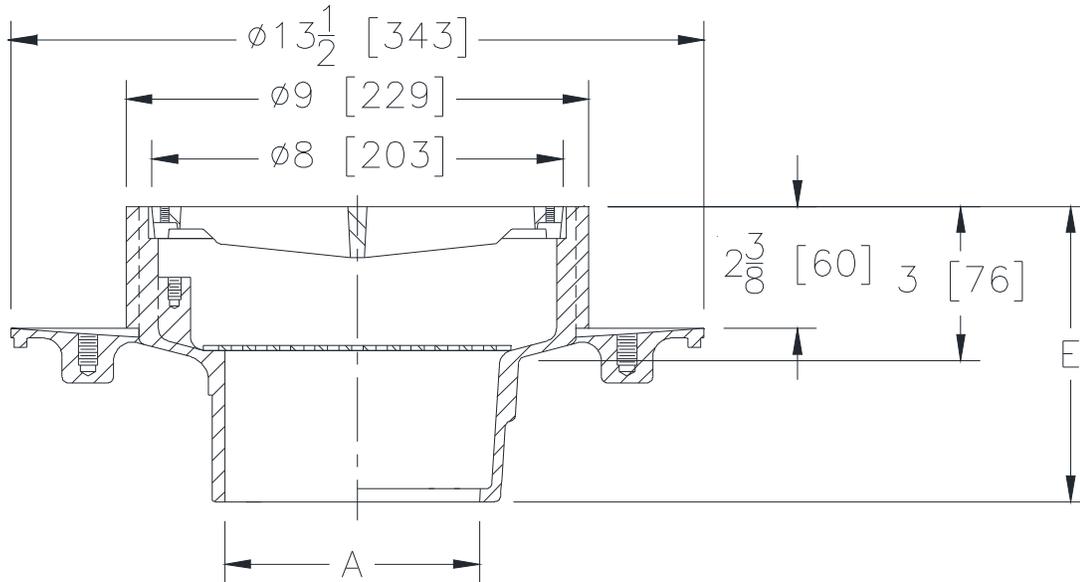

A Pipe Size In. [mm]	Approx Wt. Lbs. [kg]	Grate Open Area Sq. In. [cm ²]
2,3,4 [51,76,102]	15 [6]	18 [116]

ENGINEERING SPECIFICATION: ZURN Z1970-K
Sani-Flor receptor 9" [229mm] diameter x 3" [76mm] deep cast iron body and anchor flange with seepage holes, round slotted medium duty grate, with white acid resisting coated interior and top, complete with brass secondary strainer.

OPTIONS (Check/specify appropriate options)

PIPE SIZE

(Specify size/type) **OUTLET**

'E' BODY HT. DIMENSION

2,3,4 [51,76,102]
2,3,4 [51,76,102]

___ NH No-Hub
___ NL Neo-Loc

Z **ZN**
5-3/4 [146] 6 [152]
4-7/8 [124] 5-1/8 [130]

PREFIXES

- ___ Z Cast Iron Body with White A.R.C. Interior*
- ___ ZN Cast Iron Body with White A.R.C. Interior, 9 [229] Round Nickel Bronze Frame and Full Slotted Grate

SUFFIXES

- ___ -P 1/2 [13] Trap Primer Connection
- ___ -TC Neo-Loc Test Cap Gasket (2,3,4 [51,76,102] NL Outlet Only)
- ___ -2 1/2 Grate
- ___ -3 3/4 Grate
- ___ -4 Full Grate w/ 2 [51] Diameter Center Opening
- ___ -6 Grate w/ 6 [152] Diameter x 6 [152] High Funnel
- ___ -8 Grate w/ 8-7/8 x 3-5/8 x 3-3/4 [225 x 92 x 95] High Oval Funnel
- ___ -11 Vandal Proof Secured Grate
- ___ -25 White A.R.C. Bucket
- ___ -31 Stainless Steel Mesh Liner for Bucket

* Regularly furnished unless otherwise specified.