




ZN1902-K-3

12-3/8 x 12-3/8 [314 x 314] A.R.E. SANI-FLOR RECEPTOR
 10 [254] SUMP DEPTH W/ ANCHOR FLANGE,
 N.B. FRAME & 3/4 GRATE

SPECIFICATION SHEET

TAG _____

Dimensional Data (inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

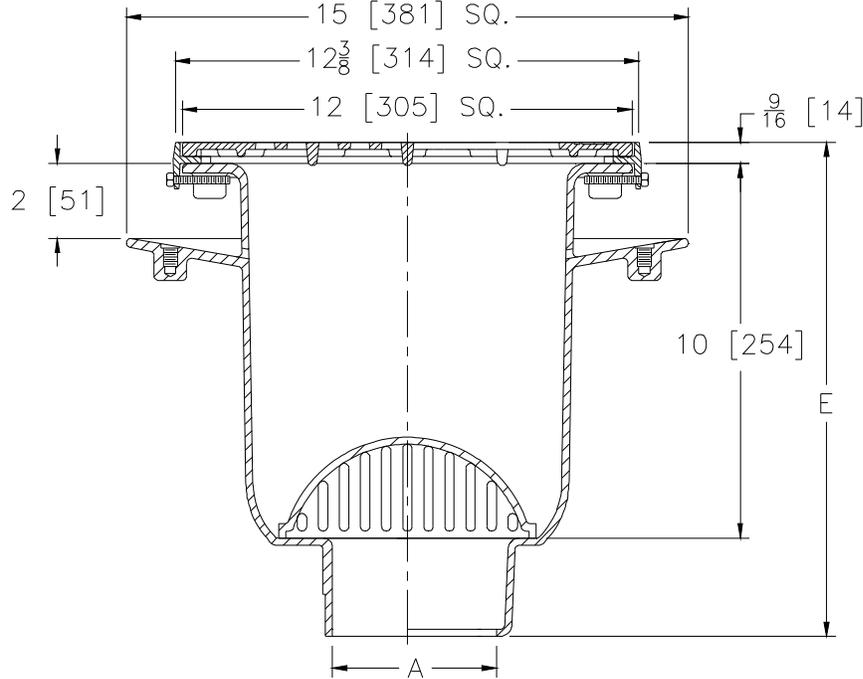

A - Pipe Size In. [mm]	Approx Wt. Lbs. [kg]	Grate Open Area Sq. In. [cm ²]
2, 3, 4 [51, 76, 102]	36 [16]	58 [374]

ENGINEERING SPECIFICATION: ZURN ZN1902-K-3 Sani-Flor Receptor 12-3/8" x 12-3/8" x 10" [314mm x 314mm x 254mm] deep cast iron body with anchor flange and seepage holes, white porcelain enamel interior, black ground enamel exterior coating, nickel bronze frame and 3/4 grate complete with white ABS anti-splash interior bottom dome strainer.

OPTIONS (Check/specify appropriate options)

PIPE SIZE

- 3, 4 [76, 102]
- 2, 3, 4 [51, 76, 102]
- 2, 3, 4 [51, 76, 102]

(Specify size/type) **OUTLET**

- ___ IC Inside Caulk
- ___ NH No-Hub
- ___ NL Neo-Loc

'E' BODY HT. DIMENSION

- 13-1/8 [333]
- 13-1/8 [333]
- 12-1/2 [317]

PREFIXES

- ___ ZN Cast Iron Body w/ White A.R.E. Interior, 12-3/8 [314] Sq. N.B. Frame & 3/4 Grate w/ 1/2 [13] Sq. Openings.*

SUFFIXES

- ___ -DX Dex-o-Tex Flange
- ___ -HP Heel-Proof Grate
- ___ -LD (Less) Bottom Dome Strainer
- ___ -P 1/2 [13] Trap Primer Connection (See Z1023)
- ___ -SA Stabilizer Assembly (See Z1903)
- ___ -TC Neo-Loc Test Cap Gasket
(2, 3, 4 [51, 76, 102] NL Bottom Outlet Only)
- ___ -VPS Vandal-Proof Strainer
- ___ -11 Vandal-Proof Secured Grate
- ___ -23 Aluminum Bucket
- ___ -25 White A.R.C. Bucket
- ___ -31 Stainless Steel Mesh Liner for Bucket
- ___ -32 Aluminum Dome Strainer
- ___ -33 White A.R.C. Anti-Splash Bottom Dome Strainer

* Regularly furnished unless otherwise specified.