




Z1970-25-31

9 [229] DIAMETER SHALLOW A.R.C. SANI-FLOR RECEPTOR 3 [76] SUMP DEPTH W/ STAINLESS MESH LINER FOR BUCKET

SPECIFICATION SHEET

TAG _____

Dimensional Data (inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

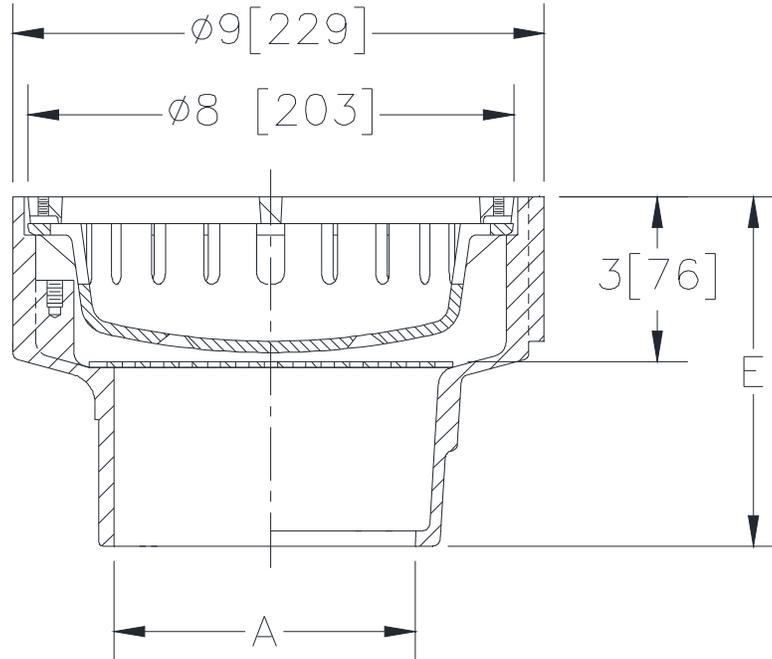

A Pipe Size In. [mm]	Approx Wt. Lbs. [kg]	Grate Open Area Sq. In. [cm ²]
2,3,4 [51,76,102]	14 [6]	18 [116]

ENGINEERING SPECIFICATION: ZURN Z1970-25-31
Sani-Flor Receptor 9" [229mm] diameter x 3" [76mm] deep cast iron body and round slotted medium duty grate, with white acid resisting coated interior and top, with brass secondary strainer, and stainless steel mesh liner for white A.R.C. sediment bucket.

OPTIONS (Check/specify appropriate options)

PIPE SIZE

(Specify size/type) **OUTLET**

'E' BODY HT. DIMENSION

2,3,4 [51,76,102]
2,3,4 [51,76,102]

___ NH No-Hub
___ NL Neo-Loc

Z	ZN
5-3/4 [146]	6 [152]
4-7/8 [124]	5-1/8 [130]

PREFIXES

- ___ Z Cast Iron Body with White A.R.C. Interior*
- ___ ZN Cast Iron Body with White A.R.C. Interior, 9 [229] Round Nickel Bronze Frame and Full Slotted Grate

SUFFIXES

- | | |
|--|--|
| ___ -K Anchor Flange with Seepage Holes | ___ -4 Full Grate With 2 [51] Diameter Center Opening |
| ___ -KC Anchor Flange with Seepage Holes and Clamp Collar | ___ -5 Grate w/ 4 [102] Diameter x 3-3/4 [95] High Funnel |
| ___ -P 1/2 [13] Trap Primer Connection | ___ -7 Grate w/ 6-3/4 x 3 x 1 [171 x 76 x 25] High Oval Funnel |
| ___ -TC Neo-Loc Test Cap Gasket (2,3,4 [51,76,102] NL Outlet Only) | ___ -11 Vandal Proof Secured Grate |
| ___ -2 1/2 Grate | |
| ___ -3 3/4 Grate | |

* Regularly furnished unless otherwise specified.