




Z1930-33

8 X 4 [203 X 102] A.R.C. SANI-FLOR RECEPTOR
4 [102] SUMP DEPTH W/ BOTTOM DOME STRAINER

SPECIFICATION SHEET

TAG _____

Dimensional Data (inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

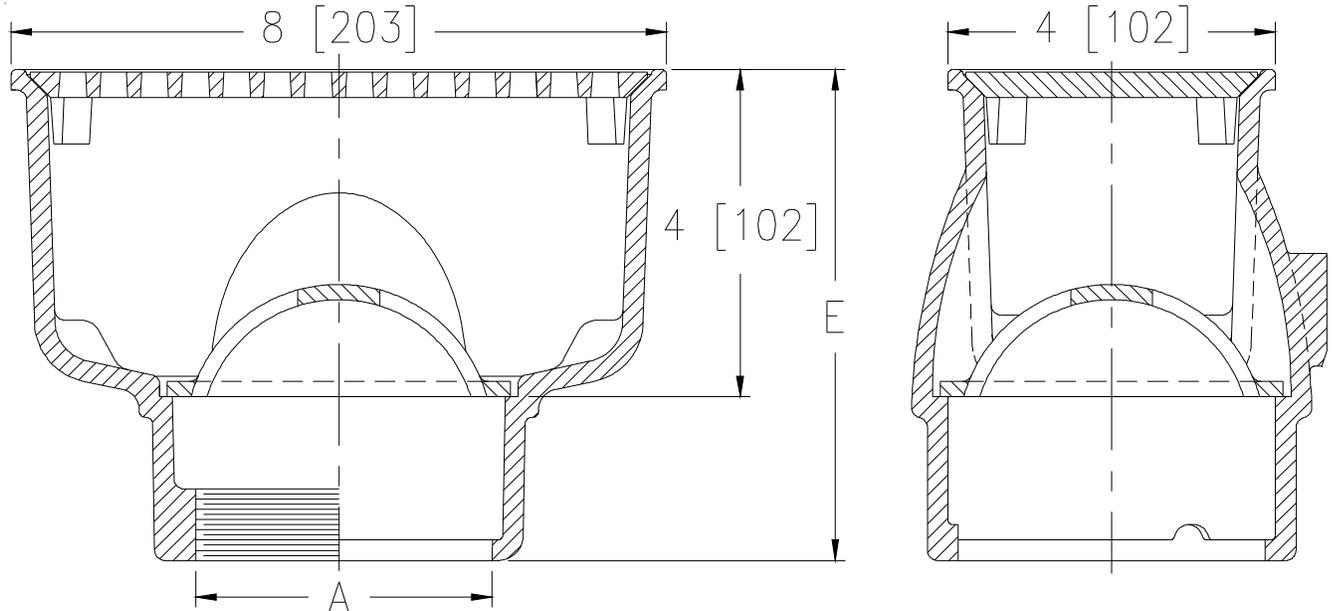

A- Pipe Size In [mm]	Approx. Wt. Lbs. [kg]	Grate Open Area Sq. In. [cm ²]
2,3 [51,76]	11 [5]	7.5 [48]

ENGINEERING SPECIFICATION: ZURN Z1930-33

Sani-Flor Receptor 8" x 4" x 4" [203mm x 102mm x 102mm] deep cast iron body and rectangular square hole light duty grate, with white acid resisting epoxy coated interior and top, and white A.R.C. anti-splash bottom dome strainer.

OPTIONS (Check/specify appropriate options)

PIPE SIZE

(Specify size/type) **OUTLET**

'E' BODY HT. DIMENSION

3 [76]
2,3 [51,76]
2,3 [51,76]

___ IC Inside Caulk
___ IP Threaded
___ NL Neo-Loc

Z **ZN**
6 [152] 6-3/8 [162]
6 [152] 6-3/8 [162]
5-13/16 [148] 6-3/16 [157]

PREFIXES

- ___ Z Cast Iron Body with White A.R.C. Interior*
- ___ ZN Cast Iron Body with White A.R.C. Interior, 8-3/4 x 4-3/4 [222 x 121] Nickel Bronze Frame and Full Grate with 5/16 [8] Square Openings

SUFFIXES

- ___ -K Anchor Flange with Seepage Holes
- ___ -KC Anchor Flange with Seepage Holes and Clamp Collar
- ___ -LD Less Bottom Dome Strainer
- ___ -P 1/2 [13] Trap Primer Connection
- ___ -TC Neo-Loc Test Cap Gasket (2,3 [51,76] NL Bottom Outlet Only)
- ___ -1 Less Grate
- ___ -2 1/2 Grate
- ___ -3 3/4 Grate
- ___ -4 Full Grate with Square Center Opening
- ___ -6 Grate w/ 6 [102] Diameter x 6 [152] High Funnel
- ___ -8 Grate w/ 8-7/8 x 3-5/8 x 3-3/4 [225 x 92 x 95] High Oval Funnel
- ___ -11 Vandal-Proof Secured Grate
- ___ -15 Solid Loose Set Cover

* Regularly furnished unless otherwise specified.