
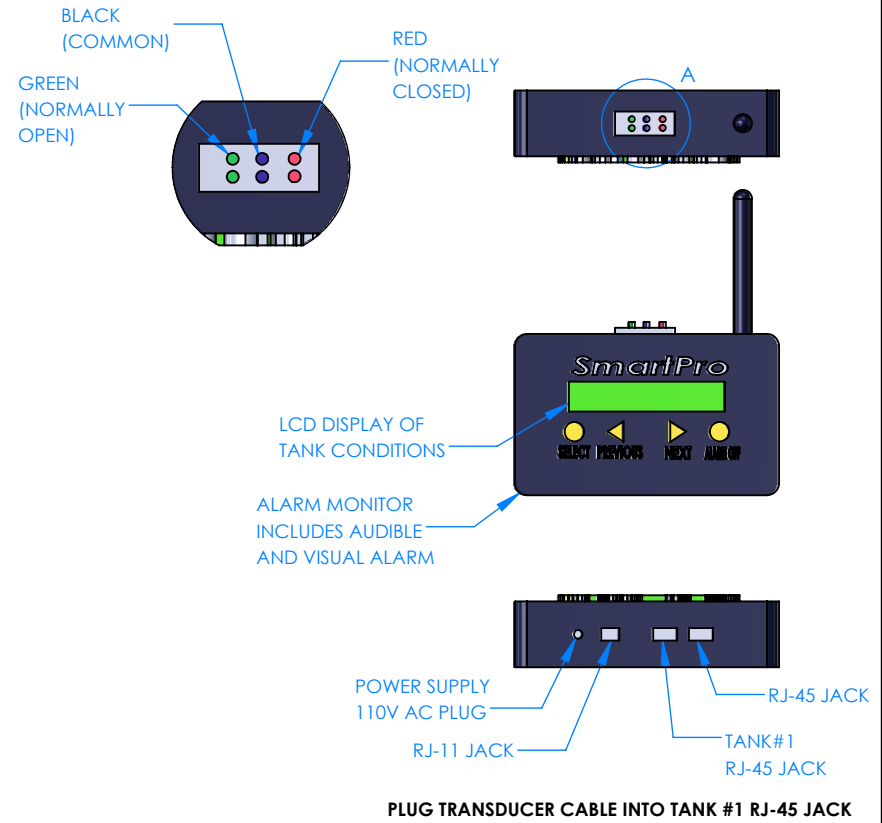


SEE OWNER'S MANUAL FOR CALIBRATION PROCEDURE

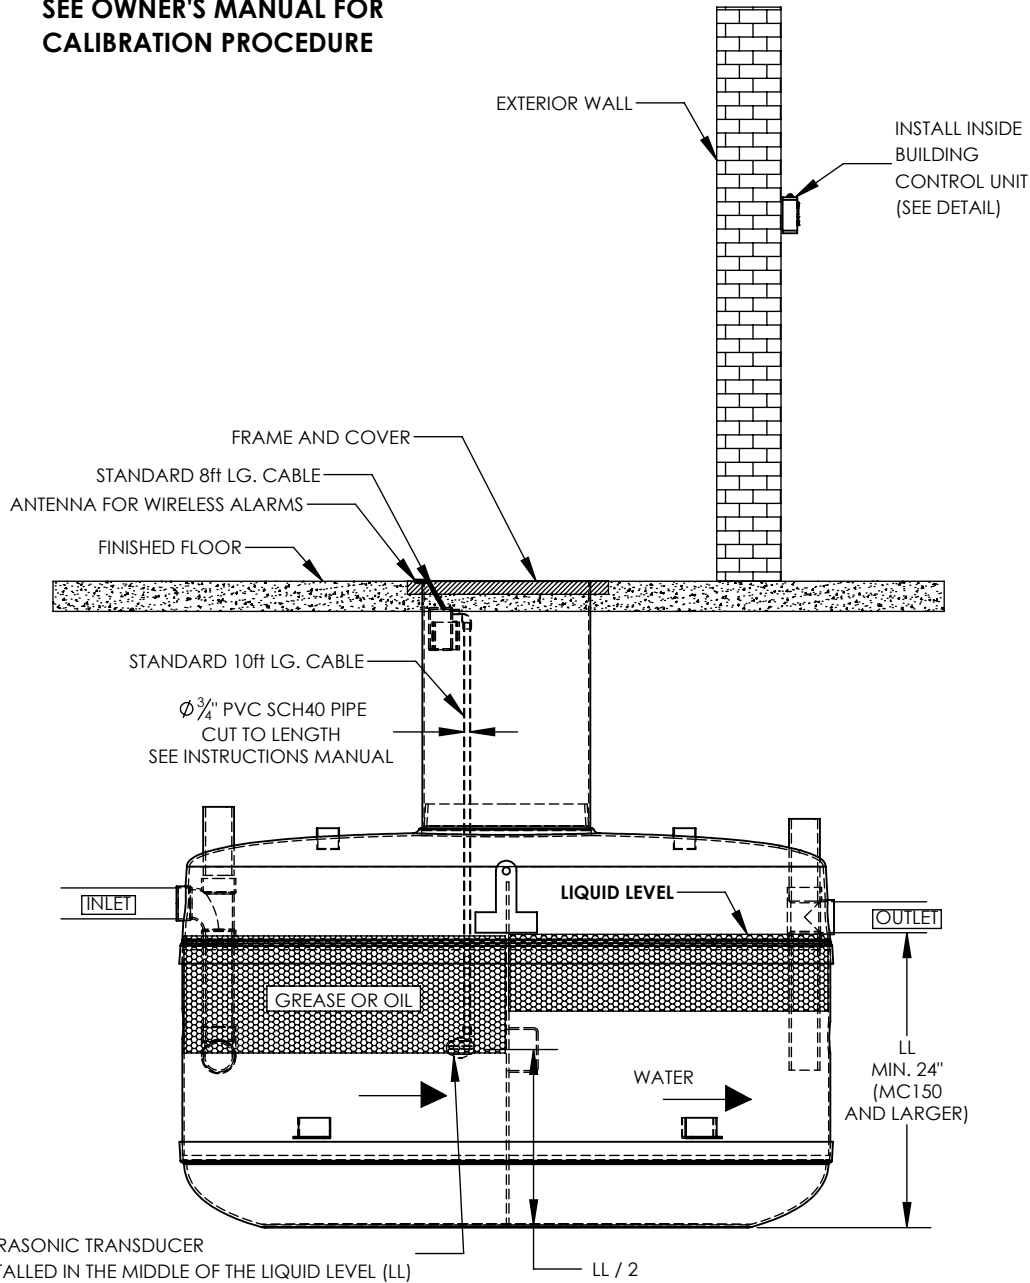

ULTRASONIC TRANSDUCER
INSTALLED IN THE MIDDLE OF THE LIQUID LEVEL (LL)

1. TANKS INSTALLED IN SERIES (EX. GMC 2000(2)) WILL HAVE ALARM INSTALLED IN THE FIRST TANK OUTLET SIDE
2. SINGLE TANKS (WITH BAFFLE) WILL HAVE ALARM INSTALLED ON THE INLET SIDE (BOTH INLET AND OUTLET INSTALLATION IS ALLOWED BUT GT RECOMMENDS INLET)

ALARM IS SHOWN TO BE INSTALLED
ON INLET SIDE OF TANK

SKU 4630
INTERNAL PART #G4-4641

DWG. TITLE:
SMARTPRO WIRELESS
ALARM G4 INLET SIDE
INSTALLATION

PROJECT:



SIZE A DRAWING NOT TO SCALE

DWG #: **21-5529-S** REV. 0