
## PROCEPTOR GMC SINGLE TANK DUAL MANWAY ELLIPSE MODELS ABOVE GROUND INSTALLATION PROCEDURE



- 1. ENSURE FLOOR IS LEVEL, SMOOTH, AND IS ABLE TO SUPPORT THE WEIGHT OF THE TANKS FULL OF WATER AT INSTALLATION LOCATION.
- 2. MOVE TANKS INTO POSITION. CHECK FIT AND LOCATION OF INLET, OUTLET AND VENT PIPING (WHERE APPLICABLE).
- 3. ENSURE ACCÈSSWAY IS ACCESSIBLE FOR COVER REMOVAL AND PUMPOUT AS WELL AS ACCESS TO THE INTERIOR. ENSURE ALL OTHER PORTS ARE ACCESSIBLE FOR INSTALLATION AND MAINTENANCE. ALARM PROBES (IF SUPPLIED) SHOULD HAVE SUFFICIENT HEADSPACE
- FOR REMOVAL TO CALIBRATE OR SERVICE. 4. ENSURE AREA AROUND TANK IS HEATED TO PREVENT FREEZING OF WATER.
- IN TANK AND PIPES.
- 5. THE STABILIZATION SUPPORTS MAY BE AFFIXED TO FLOOR IF DESIRED.
- 6. SEISMIC RESTRAINTS TO BE PROVIDED BY OTHERS IF REQUIRED BY LOCAL AUTHORITIES
- 7. INSTALL INLET, OUTLET AND VENT PIPES TO MEET LOCAL PLUMBING CODE.
- 8. PRIOR TO COMMENCING OPERATIONS, FILL TANK WITH CLEAN WATER.
- 9. US PATENT # 5,746,912; CDN PATENT # 2,195,822
- 10. PROCEPTOR SEPARATORS MUST BE INSTALLED IN ACCORDANCE WITH ALL RELEVANT FEDERAL, PROVINCIAL,/STATE, AND LOCAL CODES INCLUDING LOCAL PLUMBING CODE.

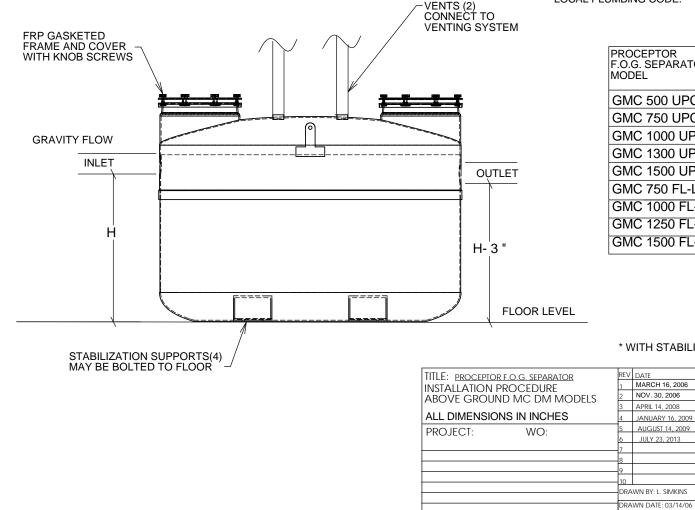

PROCEPTOR F.O.G. SEPARATOR MODEL	INLET INVERT TO TANK BOTTOM (H)	WEIGHT OF TANK FULL OF WATER (lbs)
GMC 500 UPC	33"	4740
GMC 750 UPC-LEA*	46"	6935
GMC 1000 UPC-LEA*	60"	9100
GMC 1300 UPC-LEA*	75"	11700
GMC 1500 UPC-LEA*	86"	13430
GMC 750 FL-LEA*	46"	6935
GMC 1000 FL-LEA*	60"	9100
GMC 1250 FL-LEA*	75"	11700
GMC 1500 FL-LEA*	86"	13430

## \* WITH STABILIZATION SUPPORTS TO PREVENT TIPPING

DATE MARCH 16, 2006 NOV. 30, 2006 APRIL 14, 2008	DRAWN L. SIMKINS L. SIMKINS L. SIMKINS	1		oceptor <sup>®</sup>
JANUARY 16, 2009 AUGUST 14, 2009 JULY 23, 2013	L. SIMKINS L. SIMKINS S. MANGAT	1 US	877	greenturtle <sup>®</sup> 428 8187 CAN 877 966 9444 greenturtletech.com
WN BY: L. SIMKINS		A Install MC DM Above Ground 6		
WN DATE: 03/14/06		SCAL	E:1:35	DO NOT SCALE DRAWING SHEET 1 OF 1