


NOTES:

1. REFER TO INSTALLATION PROCEDURE AND INSTALLATION CHECKLIST
2. GEOTEXTILE FABRIC SHOULD BE USED IF THE NATIVE SOIL HAS SMALL PARTICLES AND MORE THAN 3% OF ITS WEIGHT PASSING THROUGH A #8 SIEVE (2.38mm SQUARE SCREEN OPENING) REGARDLESS OF THE BACKFILL MATERIAL
3. ZURN INTERCEPTORS MUST BE INSTALLED IN ACCORDANCE WITH ALL RELEVANT FEDERAL, PROVINCIAL/STATE, AND LOCAL CODES INCLUDING LOCAL PLUMBING CODE
4. UNIT MUST BE INSTALLED WITH PROVIDED FLOW CONTROL
5. STANDARD BURIAL DEPTH IS 3 FEET WITH SUPPLIED EXTENSION COLLARS. FOR BURIAL DEPTH UP TO 6 FEET MAXIMUM, ADDITIONAL 3 FEET LONG EXTENSION COLLAR COUPLINGS (PART Z250H EXT B) MAY BE PURCHASED. BURIAL DEPTH NOT TO EXCEED 6 FEET TOTAL
6. ZURN GREENTURTLE RECOMMENDS THE INSTALLATION OF THE ANCHORING SLAB TO SECURE TANK DURING INSTALLATION. CAST IN PLACE ANCHORING SLAB TO USE AT LEAST 3000PSI CONCRETE POURED ALL AROUND TANK. APPROXIMATELY 16CU FT NEEDED
7. IF ANCHORING SLAB IS NOT INSTALLED IT IS THE INSTALLERS RESPONSIBILITY TO ENSURE THE TANK IS SECURED AND WILL NOT SHIFT OR MOVE DURING INSTALLATION
8. BACKFILL MATERIAL TO BE 3/4" PEA GRAVEL (ALTERNATIVE TO BE 3/4" CRUSHED STONE - SHALL BE COMPACTED TO 98% SPD)
9. VENTS TO BE CONNECTED TO VENTING SYSTEM, AS PER LOCAL CODES
10. CLEANOUTS TO BE CAPPED IN FIELD, AS PER LOCAL CODES
11. IF THE GROUND WATER TABLE IS MORE THAN ONE FOOT HIGHER THAN THE BOTTOM OF THE TANK, A CUSTOM DESIGN TANK AND PROPER ANTI BUOYANCY SLAB SHOULD BE USED. PLEASE CONTACT GT FOR MORE INFORMATION.n

MODEL	DRY WEIGHT
FOG-Ceptor Z250H-MD IN SERIES	300 LBS [136 KG] EACH

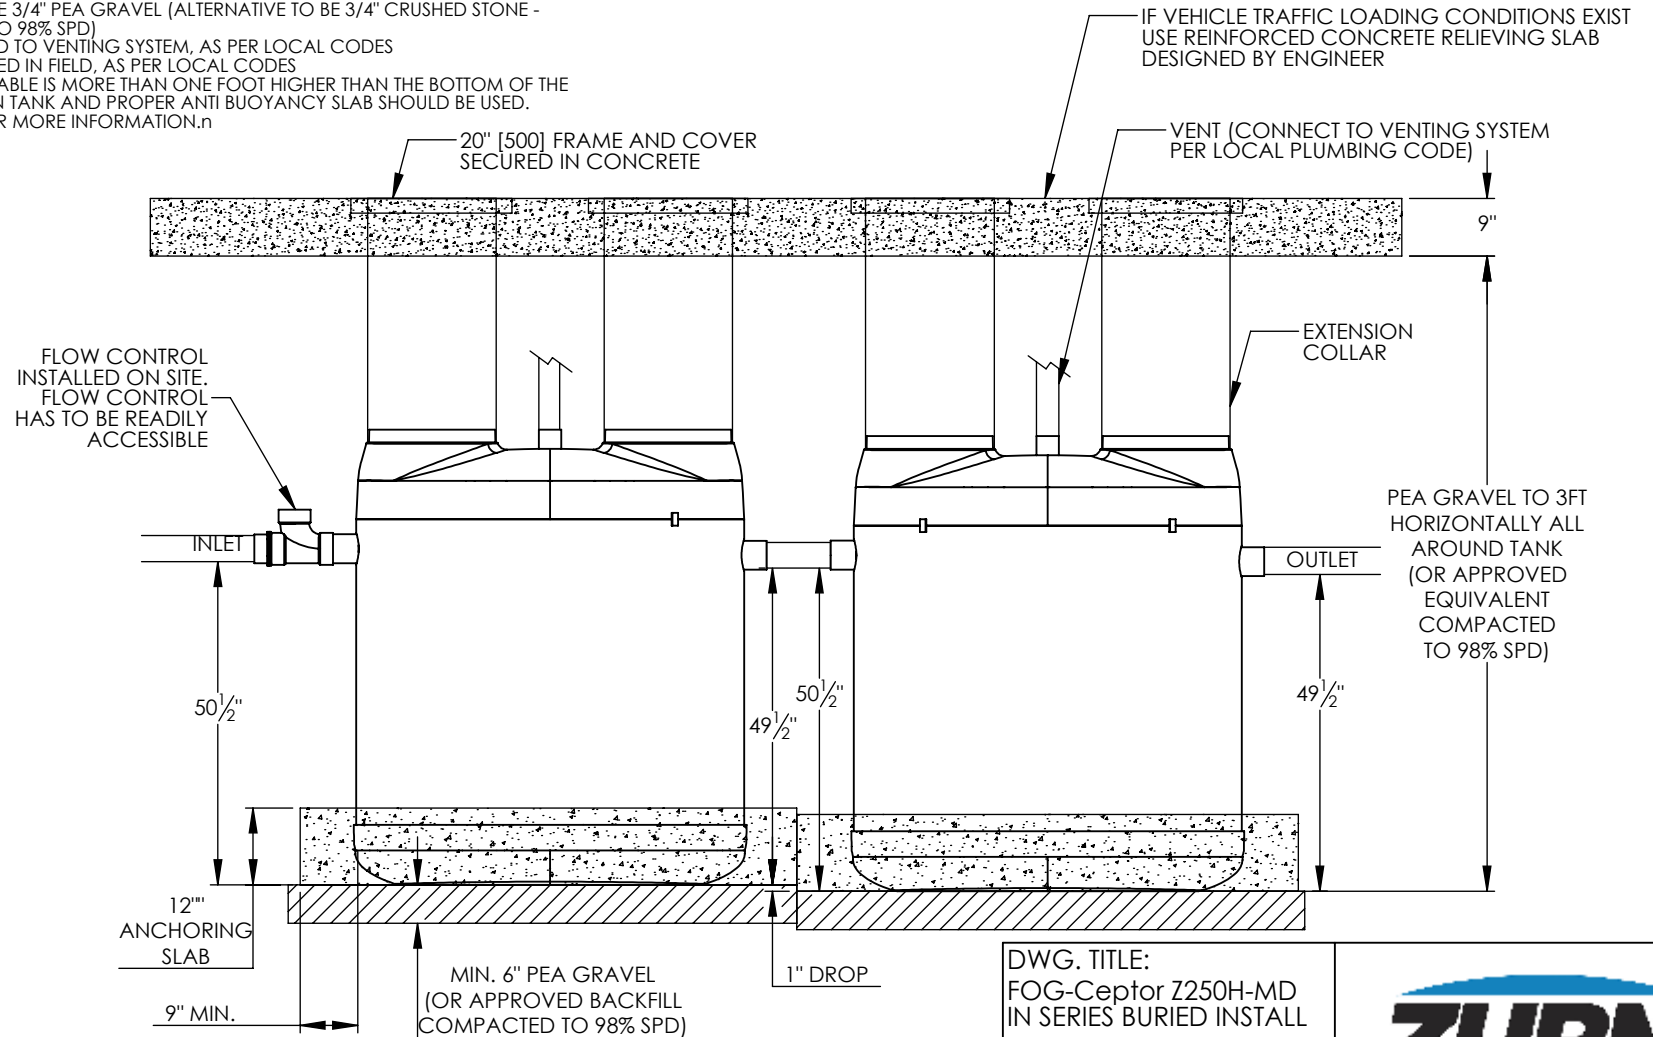

MUST BE INSTALLED WITH SUPPLIED FLOW CONTROL DEVICE AS TESTED AND AS SHOWN IN THE DRAWING

DWG. TITLE:
FOG-Ceptor Z250H-MD
IN SERIES BURIED INSTALL

PROJECT:

SIZE
A

DRAWING NOT TO SCALE

DWG #: 20-5335-S

REV. 1

